

AN ORDINANCE AMENDING ALBANY MUNICIPAL CODE CHAPTER 17.28 UNIFORM FIRE CODE.

WHEREAS, the State of Oregon has adopted the 1996 edition of the Oregon Uniform Fire code authorized by ORS 476.030 with an effective date of April 1, 1996, and is based on the 1994 edition of the Uniform Fire Code; and

WHEREAS, the Albany Fire Department is dedicated to fire and life safety; and

WHEREAS, the City of Albany adopts a locally amended State of Oregon 1996 Edition of the Oregon Uniform Fire Code.

THE PEOPLE OF THE CITY OF ALBANY DO ORDAIN AS FOLLOWS:

Section 1:

Albany Municipal Code 17.28.010 is amended to read as follows: 17.28.010 Adopted. There is hereby adopted by the City of Albany for the purpose of prescribing regulation governing conditions hazardous to life and property, explosions and panic, that certain code known as the Uniform Fire Code recognized by the International Fire Code Institute, the Western Fire Chiefs Association, and the International Conference of Building Officials, being particularly the amended version of the ~~1985~~ 1994 edition as adopted by the State of Oregon, including the table of contents; ~~Appendix I-A, II-E, III-A, III-C, V-A, VI-A, VI-B, VI-D, Appendices I-A, I-C, I-D, I-E, I-F, II-A, II-B, II-D, II-E, A-II-E-1, II-F, II-G, II-H, II-I, III-A, III-B, III-C, V-A, VI-A, VI-B, VI-D, VI-E, VI-F, VI-G;~~ and the index, save and except such portions as are hereinafter deleted, modified, or amended in ~~Appendix A~~ in AMC Section 17.28.150 of this ordinance of which code appendices are on file in the office of the Bureau of Fire Prevention Division. All secondary codes and standards referred to in ~~Section 2.304(a)~~ Article 90 of the Uniform Fire Code and in this chapter as amended are hereby adopted and are on file and open to public inspection in the office of the Bureau of Fire Prevention Division and the same are hereby adopted and incorporated fully as though set out at length herein, and from the date on which the ordinance codified in this chapter shall take effect, the provisions thereof shall be controlling within the limits of the City of Albany.

Section 2:

Albany Municipal Code 17.28.110 is amended to read as follows: 17.28.110 Appeals.

- (1) Whenever the Supervisor of the Fire Prevention Division disapproves an application or refuses to grant a permit applied for and it is claimed that the provisions of the code do not apply or that the true intent and meaning of the code have been misconstrued or wrongly interpreted, the applicant may appeal the decision of the Supervisor to the Board of Appeals, which is designated by City Council and is the same as the Building Board of Appeals. If they do not concur with the Board of Appeals' decision, they may appeal the decision of the Board to the City Council.
- (2) Appeals may be filed by the following parties affected by the decision:
 - (a) The owner of his/her authorized agent.
 - (b) Any resident or property owner within 150 feet of a parcel of land that is the subject of the decision.
- (3) Appeals to the Board of Appeals must be filed within 10 calendar days from the date of the decision of the Fire Chief.
- (4) Appeals to the City Council must be filed with the City Recorder within 30 days from the date of the decision of the Board of Appeals.

- (5) Appeals shall be filed in writing and should include:
- (a) The name and address of the appellant.
 - (b) The address of the parcel that is subject of the decision.
 - (c) The date of the decision.
 - (d) The nature of the Chief Fire Prevention Bureau Division decision.
 - (e) A statement of the applicable code section and the specific ground for appeal.
 - (f) A filing fee as specified by ordinance or resolution.

Section 3:

Albany Municipal Code 17.28.130 is amended to read as follows: 17.28.130 Uniform Fire Code - Appendices. Appendices I-A, II-E, III-A, III-C, V-A, VI-A, VI-B, and VI-D I-A, I-C, I-D, I-E, I-F, II-A, II-B, II-D, II-E, A-II-E-1, II-F, II-G, II-H, II-I, III-A, III-B, III-C, V-A, VI-A, VI-B, VI-D, VI-E, VI-F, and VI-G of the Uniform Fire Code are on file for public inspection in the office of the Bureau of Fire Prevention Division and are hereby made a part of the Uniform Fire Code, 1988 1994 Edition.

Section 4:

Albany Municipal Code 17.28.140 is amended to read as follows: 17.28.140 Inspections. The Fire Department as part of its fire prevention activities as directed by the Fire Chief may inspect all Group A, Group B, Group E, Group F, Group H, Group I, Group M, Group R, and Group SR, and Group U occupancies within the City of a frequency as established by Fire Department Standard Operating Procedures.

Section 5:

Albany Municipal Code 17.28.150 is amended to read as follows: 17.28.150 Local Amendments. As part of the adoption cycle for the Uniform Fire Code are the following Amendments: Article 1 Section 1.103(d); Article 4 Section 11.105, 11.110, 11.111, 11.112; Article 10 Section 77.104(a), (b), (c), (d), (e), 77.105, 77.106, 77.107, 77.108; Article 78 Section 78.101, 78.102(a), (b), (c), (d), (e), (f), 78.103(a), (b), (c), 78.104, 78.105, 78.106; Article 79 Section 79.402, 79.902(c), (e), 79.903(b), (f), 79.911(d); Article 80: The Uniform Fire Code, within the jurisdiction of the city of Albany, shall be amended as follows:

ARTICLE 1: ADMINISTRATION

SECTION 103: INSPECTION AND ENFORCEMENT

103.1.4 Appeals: To determine that suitability of alternate materials and types of construction and to provide for reasonable interpretations of the provisions of this code, there shall be and hereby is created a Board of Appeals consisting of five members who are qualified by experience and training to pass judgment upon pertinent matters. The Fire Chief shall act as secretary of the Board. The Board of Appeals shall mean Building Board of Appeals and be appointed by the executive body and shall hold office at their pleasure. The Building Board of Appeals shall adopt reasonable rules and regulations for conducting its investigations and shall render decisions and findings in writing to the Fire Chief, with a duplicate copy to the appellant.

ARTICLE 1: ADMINISTRATION

SECTION 105: PERMITS

105.8.a Permit Required: A permit shall be obtained from the Fire Prevention Division prior to engaging in the following activities, operations, practices, or functions:

- a. **Aboveground and Underground Tank Installations:** To install tanks for the storage of flammable or combustible liquids aboveground and underground.

- b. **Removal or Decommissioning Tanks:** To remove or decommission above or below ground flammable or combustible liquid tanks.
- c. **Automatic Fire Extinguishing Systems:** For approved automatic fire-extinguishing systems for the protection of commercial-type cooking.
- d. **Carnivals and fairs including amusement facilities, people's expositions, and shows:** To conduct, business for entertainment purposes. See Article 25. UFC 1994.
- e. **Fireworks for retail sales, display, and storage:** Requirements for fireworks shall comply with Article 78 and the State Fire Marshal
- f. **Fire Detection System:** A permit may be required for the installation of an approved fire detection system.
- g. **Soil Remediation:** A permit for the inspection and/or recovery of soils shall be obtained from the local jurisdiction. Contractor shall be certified by State of Oregon under DEQ Remediation Program.

ARTICLE 9: FIRE DEPARTMENT ACCESS AND WATER SUPPLY
SECTION 901: GENERAL

901.4.4. Premises identification: Approved numbers or addresses shall be placed on all new and existing buildings in such a position as to be plainly visible and legible from the street or road fronting the property.

- a. Mall /facilities are required to have each separate business clearly identified.
- b. Mall /facilities shall post addresses on front and rear access doors.
- c. Each mall owner/lessee shall provide the Fire Department a location site plan for firefighting purposes.
- d. Buildings under new construction are required to display visible street addresses prior to ground breaking.

“Addresses shall comply with NFPA 299 5-9 as provided: Letters, numbers, and symbols indicating addresses shall be a minimum of 4 inches (101.6) in height with a ½-inch (12.7mm) stroke, shall be contrasting with background letters, numbers, and symbols indicating addressees shall be a minimum of 4 inch, colors, and shall be visible from the road.”

ARTICLE 9: FIRE DEPARTMENT ACCESS AND WATER SUPPLY
SECTION 902: FIRE DEPARTMENT ACCESS

902.1.a General: Buildings shall be accessible to Fire Department apparatus. Fire Department access roads shall be provided and maintained in accordance with Sections 901 and 902.

902.2.1 Required access: Fire apparatus access roads shall be provided in accordance with Sections 901 and 902.2 for every facility, building, or portion of a building hereafter constructed or moved into or within the jurisdiction when any portion of the facility or any portion of an exterior wall of the first story of the building is located more than 150 feet from a public right-of-way as measured by an approved route around the exterior of the building or facility. See also Section 902.3 for personnel access to buildings.

Exceptions:


- 1. When it is determined by the Fire Chief that access by a single road might be impaired by vehicle congestion, condition of terrain, climatic conditions, or other factors more than one access road may be required.
- 2. When approved sprinkler systems are installed and maintained in buildings or structures, the Fire Chief may deem secondary access roads unnecessary.

902.2.1.a Fire lane: When any portion of the facility or building is in excess of 150 feet from a water supply on a public right-of-way as measured by an approved route around the exterior of the facility or building, the Fire Chief may designate a fire lane.

902.2.4.2.a Gates and barriers: Secured gates and barriers that restrict Fire Department access shall be provided with an approved keybox(es).

1. Gated entrances shall provide a clear opening two feet wider than the traveled way, as per NFPA 299 4-4.12.
2. All gates shall be located an approved distance from the public right-of-way and shall open inward allowing a vehicle to stop without obstruction traffic on the public road.

902.2.2.6.a Grade: The gradient for fire apparatus access roads shall not exceed 12%, and for every 1,000 feet of incline thereafter, the grade shall be a reduced by 3% or as approved by the Fire Chief.

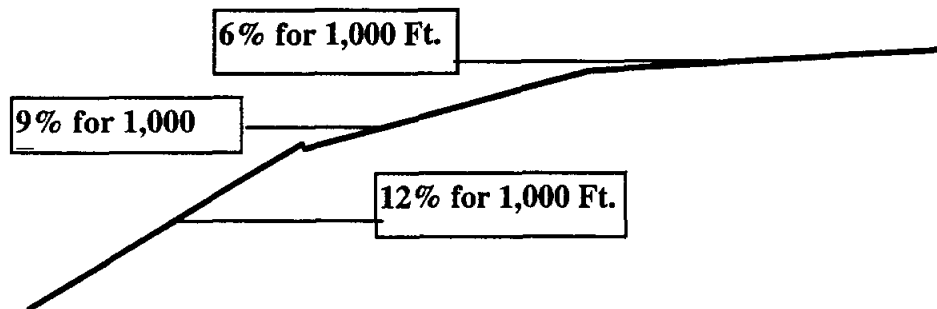

Exception:

1. When an approved fire sprinkler system is installed and maintained, grade may be increased as approved by the Fire Chief.

902.4 Key boxes: When access to or within a structure or an area is unduly difficult because of secured in openings; or where immediate access is necessary for life-saving or firefighting purposes; or in structures with fire detection, fire sprinkler, and fire monitoring systems, the Fire Chief is authorized to require a key box to be installed in an accessible location. The key box shall be of a type approved by the Fire Chief and shall contain keys to gain necessary access.

ARTICLE 9: FIRE DEPARTMENT ACCESS AND WATER SUPPLY

SECTION 903: WATER SUPPLIES AND FIRE HYDRANTS

903.2.a Required water supply for fire protection: An approved water supply capable of supplying the required fire flow for fire protection shall be provided to all premises upon which facilities, buildings, or portions of buildings that are located within the Albany Fire Department's jurisdiction. When any portion of the facility or building protected is in excess of 150 feet (45,720 mm) from a water supply on a public street, as measured by an approved route around the exterior of the facility or building, on-site fire hydrants and mains capable of supplying the required fire flow shall be provided when required by the Fire Chief. See Section 903.4.

**ARTICLE 10: FIRE PROTECTION SYSTEMS AND EQUIPMENT
SECTION 1001: GENERAL**

1001.4 Approval and testing: Fire alarm systems; fire hydrant systems; fire-extinguishing systems, including automatic sprinklers and wet and dry standpipes; halon systems and other special types of automatic fire-extinguishing systems; basement pipe inlets; and other fire-protection systems and appurtenances thereto shall meet the approval of the Fire Department as to installation and location and shall be subject to such periodic tests as required by the Fire Chief. See appropriate NFPA chapters, Appendix III-C, and UFC 10-4 or specific nationally-recognized standards.

- a. When fire detection or fire sprinkler systems are existing in structures, the provisions of NFPA 13, 13R, and Appendix III-C shall be followed. The fire sprinkler contractor shall provide the Fire Chief annually with a copy of the contractor's test certificate for each fire sprinkler and fire detection system tested.
- b. Fire detection systems: For the installation of fire detection monitoring systems, the contractor shall provide the Fire Marshal with a copy of his/her low voltage license prior to installation of a fire detection system.

1001.5.1.a Fire Department connections and fire sprinkler water supply control valves: Such valves and connections shall be located a minimum of 20 feet to buildings and shall not exceed a maximum of 50 feet to buildings, or as approved by the Fire Chief.

Exception:

1. When location of valves and connections are deemed impractical, the Fire Chief is authorized to re-establish its location.

**ARTICLE 10: FIRE PROTECTION SYSTEMS AND EQUIPMENT
SECTION 1007: FIRE ALARM SYSTEMS**

1007.2.a All new type V one-hour and type V non-rated buildings constructed exceeding 5,000 square feet of floor area or existing buildings of Type V one-hour and Type V non-rated which, after completion of major alteration or addition, will exceed 5,000 square feet of floor area shall be provided with an approved automatic fire detection and alarm system. Such systems shall comply with the requirements of the National Fire Protection Association and the Uniform Fire Code governing their installation and approval. Fire detection and alarm systems shall be monitored by an approved central station.

Exception:

1. Buildings that are provided throughout with an approved automatic fire sprinkler system, providing such system is equipped with an approved device to automatically transmit a water flow alarm to an approved central station upon activation of the system.

1007.2.9.1.4 Heat detectors: Heat detectors shall be provided in common areas such as recreational rooms, laundry rooms, furnace rooms, kitchens, and similar areas in accordance with UFC standard 10-3.

1. In multi-family dwellings exceeding 5,000 square feet of floor area an approved heat detector connected to an approved central station shall be installed in the kitchen(s). An approved, audible alarm shall be located on the exterior of the building.

**ARTICLE 11: GENERAL SAFETY PRECAUTIONS
SECTION 1110: VACANT BUILDINGS**

1110.4 Dangerous Buildings: The Fire Marshal is authorized to make such inspections and take such actions as may be required to enforce the provisions of the Code "Known as the Uniform Code for the Abatement of Dangerous Buildings."

**ARTICLE 52: MOTOR VEHICLE FUEL-DISPENSING STATIONS
SECTION 5202: FLAMMABLE AND COMBUSTIBLE LIQUID MOTOR VEHICLE FUEL-DISPENSING STATIONS**

5202.4.2 Filling of portable containers and cargo tank:

- 1. Fuel-dispensing of Class I, II, and III-A liquids into approved portable containers shall not be permitted when containers are located in or on a motor vehicle or marine craft.**
- 2. Portable containers shall not exceed six gallons in volume.**
- 3. Portable containers when being filled shall be located not less than three feet from motorized vehicles.**

**ARTICLE 78: FIREWORKS AND PYROTECHNIC SPECIAL EFFECTS MATERIAL
SECTION 7801: GENERAL**

7801.3.1.a Fireworks: When new types and names of fireworks become available to the public the Fire Chief is authorized to make determinations as to which fireworks could/would cause any life safety hazard and shall cause such fireworks to be banned or removed from public sale, storage, and display or any other type of public safety hazard.

II. APPENDICES

DIVISION 1 - EXISTING BUILDINGS

Appendix 1-A - Life-safety Requirements for Existing Buildings Other than High Rise

Appendix 1-C - Stairway Identification

State Adopted: As per OAR 837 Division 39 which regulates the administration of fire prevention programs.

Appendix 1-D Fire Prevention Guidelines for Haunted Houses and Similar Temporary Installations

State Adopted: As per OAR 837 Division 39 which regulates the administration of fire prevention programs.

Appendix 1-E - Adult Foster Homes

State Adopted: As per OAR 837 Division 39 which regulates the administration of fire prevention programs.

Appendix 1F - Requirements for Group SR Occupancies

Appendix II-A -Suppression and Control of Hazardous Fire Areas

Appendix II-B Protection of Flammable and Combustible Liquid Tanks in Locations Subject to Flooding

Appendix II- D -Rifle Ranges

Appendix II-E - Hazardous Materials Management Plans and Hazardous Materials Inventory Statements

Appendix A-II-E-1 - Hazardous Materials Management Plans (HMMP) Instructions

Appendix II-F - Protected Aboveground Tanks for Motor Vehicle Fuel-dispensing Stations Outside Buildings

Appendix II-G - Secondary Containment for Underground Tank Systems Containing Flammable or Combustible Liquids

Appendix II-H - Site Assessments for Deterring Potential Fire and Explosion Risk from Underground Flammable or Combustible Liquid Tank Leaks

Appendix II-I - Ozone Gas-generating Equipment

DIVISION III - FIRE PROTECTION

Appendix III-A Fire-flow Requirements for Buildings

Appendix III-B Fire Hydrant Locations and Distribution

Appendix III-C- Testing Automatic Sprinkler and Standpipe Systems

DIVISION V - STANDARDS

Appendix V-A - Nationally Recognized Standards of Good Practice

DIVISION VI - INFORMATIONAL

Appendix VI-A- Hazardous Materials Classifications

Appendix VI-B Emergency Relief Venting for Fire Exposure for Aboveground Tanks

Appendix VI-D Reference Tables from the Uniform Building Code

Appendix VI-E - Recommended Separation Distances for Explosive Materials

Appendix VI-F Refrigerant Groups and Properties

Appendix VI-G - Unit Conversion Tables

INDEX

CONVERSION TABLE

1991 Uniform Building Code

B-1
B-2
B-3
B-4
OPEN PARKING
M

1994 Uniform Building Code

S-3
B,F-1, M, S-1 & S-2
S-4 & S-5
F-2 & S-2
S-4
U

Passed by Council: October 9, 1996

Approved by Mayor: October 9, 1996

Effective Date: October 9, 1996



Mayor

ATTEST:



City Recorder